

Bulletin No. G310BK-D Drawing No. LP0612

Released: 08/13

G310C & TX700T BACKLIGHT ASSEMBLIES




CAUTION - Backlight is not field replaceable for hazardous location applications. Unit must be returned to Red Lion Controls for repair.



WARNING - EXPLOSION HAZARD - DO NOT DISCONNECT EQUIPMENT UNLESS POWER HAS BEEN DISCONNECTED AND THE AREA IS KNOWN TO BE NON-HAZARDOUS.

G310 BACKLIGHT REPLACEMENT PROCEDURE

- 1. Remove the power and PLC Communications connectors from the unit.
- 2. Remove the five screws from the rear cover.
- 3. Locate the inverter board (refer to Figure 1).
- Carefully remove heat shrink tubing from the backlight connector on the inverter board.
- 5. Carefully remove the backlight connector from its connector housing on the inverter board. (refer to Figure 1).
- 6. Depress the backlight release tab and carefully remove the backlight as indicated in Figure 2.
- 7. To install the new backlight assembly, reverse the above steps. Ensure that the florescent tubes of the backlight assembly face towards the display. Use caution when inserting the new assembly so that it is not twisted or pushed on an angle. The backlight assembly is fragile and may easily be broken.
- 8. Apply the enclosed label to the rear cover in the area indicated in Figure 3. Field replacement of the backlight assembly voids the Hazardous Locations rating of this unit.

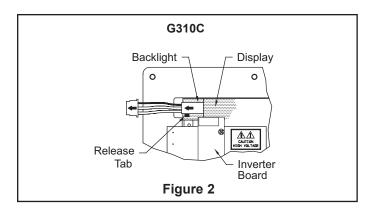

ORDERING INFORMATION

MODEL NO.	DESCRIPTION	PART NUMBER
G310	G310C/TX700T Backlight Tube, NEC-29, -46 only (Note 1)	G3BR10C0
	G310C/TX700T Backlight Tube, NEC-64R only (Note 1)	G3BR10C1

Note 1:


Refer to the part number on the rear of the display in the lower right hand corner. NEC displays with a part number ending in -29 or -46 must use G3BR10C0. NEC displays with a part number ending in -64R must use G3BR10C1. These part numbers are for use with Models G310C and TX700T.




WARNING - EXPLOSION HAZARD - THE AREA MUST BE KNOWN TO BE NON-HAZARDOUS BEFORE SERVICING/ REPLACING THE UNIT AND BEFORE INSTALLING OR REMOVING I/O, INVERTER, BACKLIGHT, WIRING AND BATTERY.

CAUTION: RISK OF ELECTRIC SHOCK

The inverter board supplies the high voltage to operate the backlight. Touching the inverter board may result in injury to personnel. Disconnect all power before installing or removing backlight assembly.

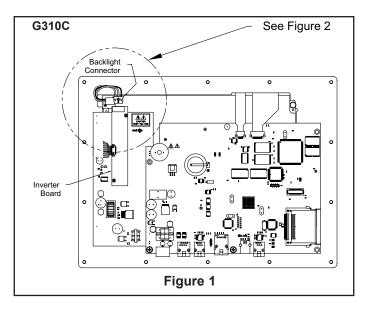

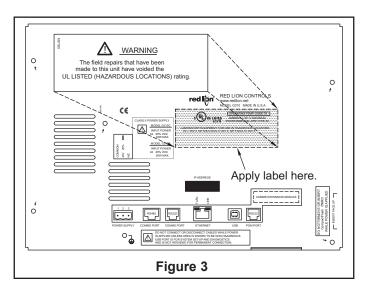

TX700T BACKLIGHT REPLACEMENT PROCEDURE




WARNING - EXPLOSION HAZARD - THE AREA MUST BE KNOWN TO BE NON-HAZARDOUS BEFORE SERVICING/ REPLACING THE UNIT AND BEFORE INSTALLING OR REMOVING I/O, INVERTER, BACKLIGHT, WIRING AND BATTERY.



WARNING - EXPLOSION HAZARD - DO NOT DISCONNECT EQUIPMENT UNLESS POWER HAS BEEN DISCONNECTED AND THE AREA IS KNOWN TO BE NON-HAZARDOUS.

- 1. Remove the power and PLC Communications connectors from the unit.
- 2. Remove the four screws from the rear cover.
- 3. Locate the inverter board (refer to Figure 1).
- Carefully remove the backlight connector from its connector housing on the inverter board. (refer to Figure 2).
- 5. Depress the backlight release tab and carefully remove the backlight as indicated in Figure 3.
- 6. To install the new backlight assembly, reverse the above steps. Ensure that the florescent tubes of the backlight assembly face towards the display. Use caution when inserting the new assembly so that it is not twisted or pushed on an angle. The backlight assembly is fragile and may easily be broken.

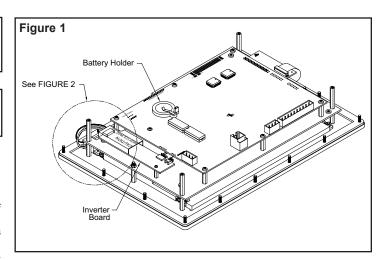



CAUTION: RISK OF ELECTRIC SHOCK

The inverter board, attached to the mounting plate, supplies the high voltage to operate the backlight. Touching the inverter board may result in injury to personnel. Disconnect all power before installing or removing backlight assembly.

